

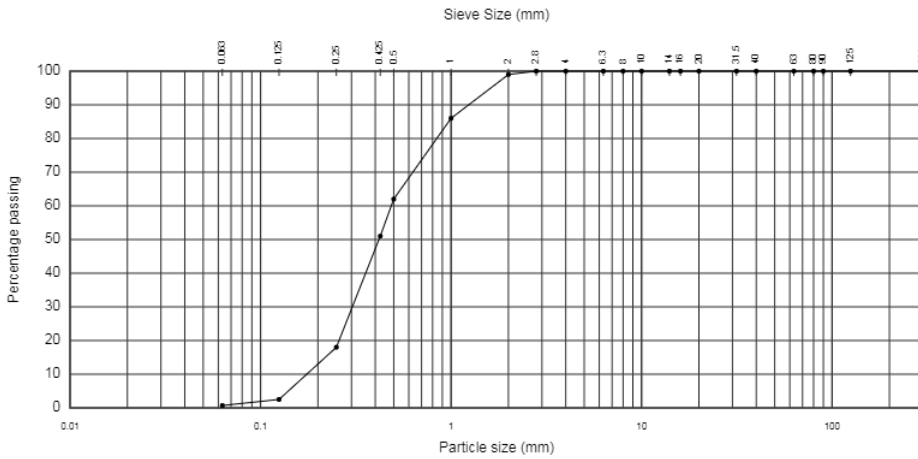
**TEST REPORT: DETERMINATION OF PARTICLE SIZE DISTRIBUTION**

BS EN 933-1 : 2012 Washing &amp; Dry Sieving

REPORT NUMBER: 601156 / 63494.10.1.1

m

SAMPLE NUMBER:	104357	CLIENT:	Land Logical Dartford Ltd
CLIENT REF:	AH02	ADDRESS:	Stone Power Plant, Cotton Lane, Greenhithe, DA9 9BB
DATE SAMPLED:	19/02/2019	SITE:	Willow Hall Lane, Thorney
SAMPLED BY:	Alex Hughes	SUPPLIER:	Landlogical, Thorney
DATE RECEIVED:	19/02/2019	MATERIAL:	0/2mm Soft Sand
DATE COMPLETED:	26/02/2019	CLASSIFICATION:	0/2mm
TESTED BY:	JM, IB, JM	LOCATION:	Stockpile

**RESULT**

**SIEVE ANALYSIS**

Particle Diameter mm	Passing %	Specification Limits
300	100	
125	100	
90	100	
80	100	
63	100	
40	100	
31.5	100	
20	100	
16	100	
14	100	
10	100	
8	100	
6.3	100	
4	100	100 - 100
2.8	100	98 - 100
2	99	85 - 99(+/-5)
1	86	(+/-20) (+/-20)
0.5	62	
0.425	51	
0.25	18	
0.125	3	
0.063	0.7	(+/-4) (+/-4)

0/2mm - PD 6682-6:2009+A1:2013 Guidance on the use of BS EN 13242:2013

**Uniformity Coefficient (D60/D10) N/A**

Sample complies with the grading specification

Moisture content: 5.8%

**Remarks:**

 A certificate of sampling is available.  
 Remaining sample will be retained for a minimum of 28 days from date of report.

Report Format: L/Rep A2EN/rev.7

 Highway House  
 6 Lutterworth Road, Wolvey  
 Warwickshire LE10 3HW

 0843 2272362  
 enquiries@cet-uk.com  
 www.cet-uk.com

 For and on behalf of CET  
 Jack Maxwell - Assistant Laboratory Manager



 Approved Signatory  
 26-Feb-19


0927

 CET is the trading name for CET Structures Limited.  
 Registered in England No. 02527130